


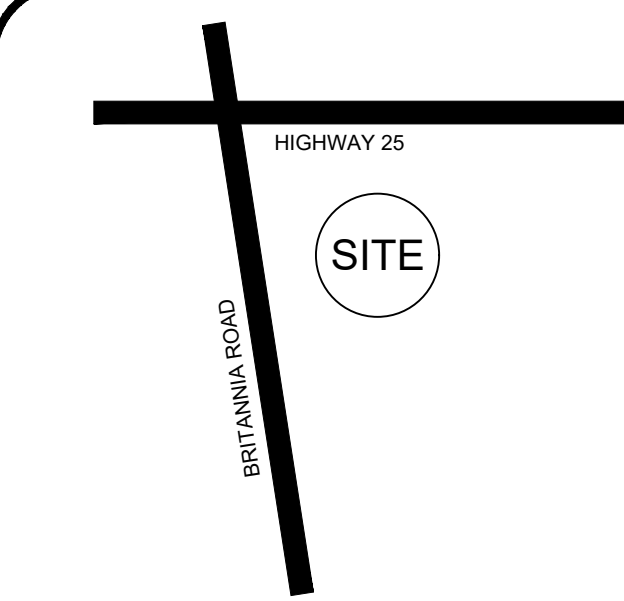
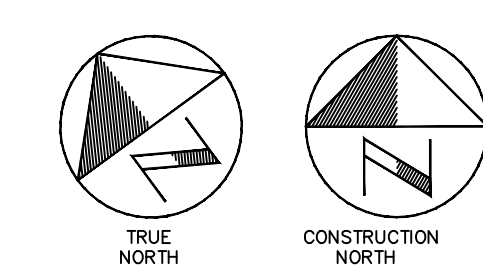
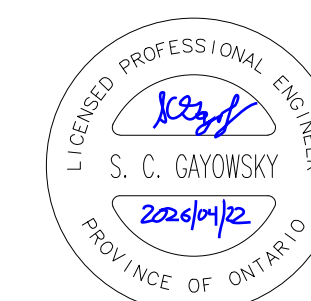


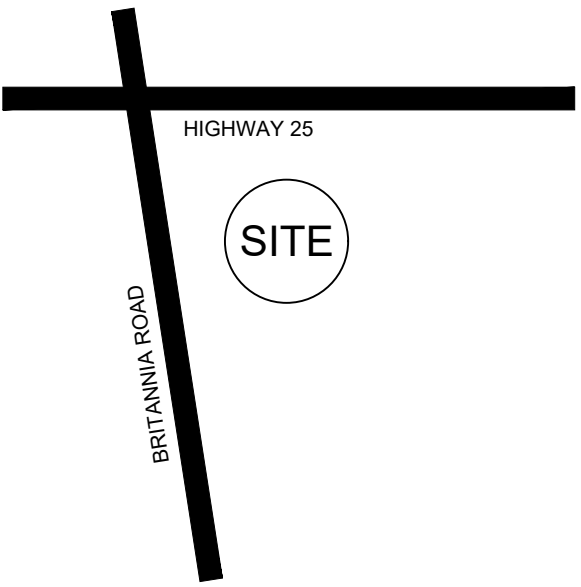

SHEET 1 OF 3

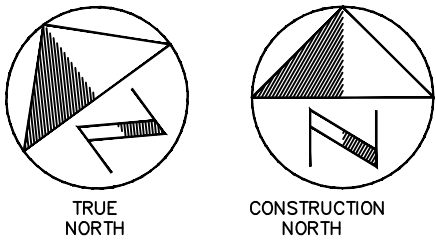

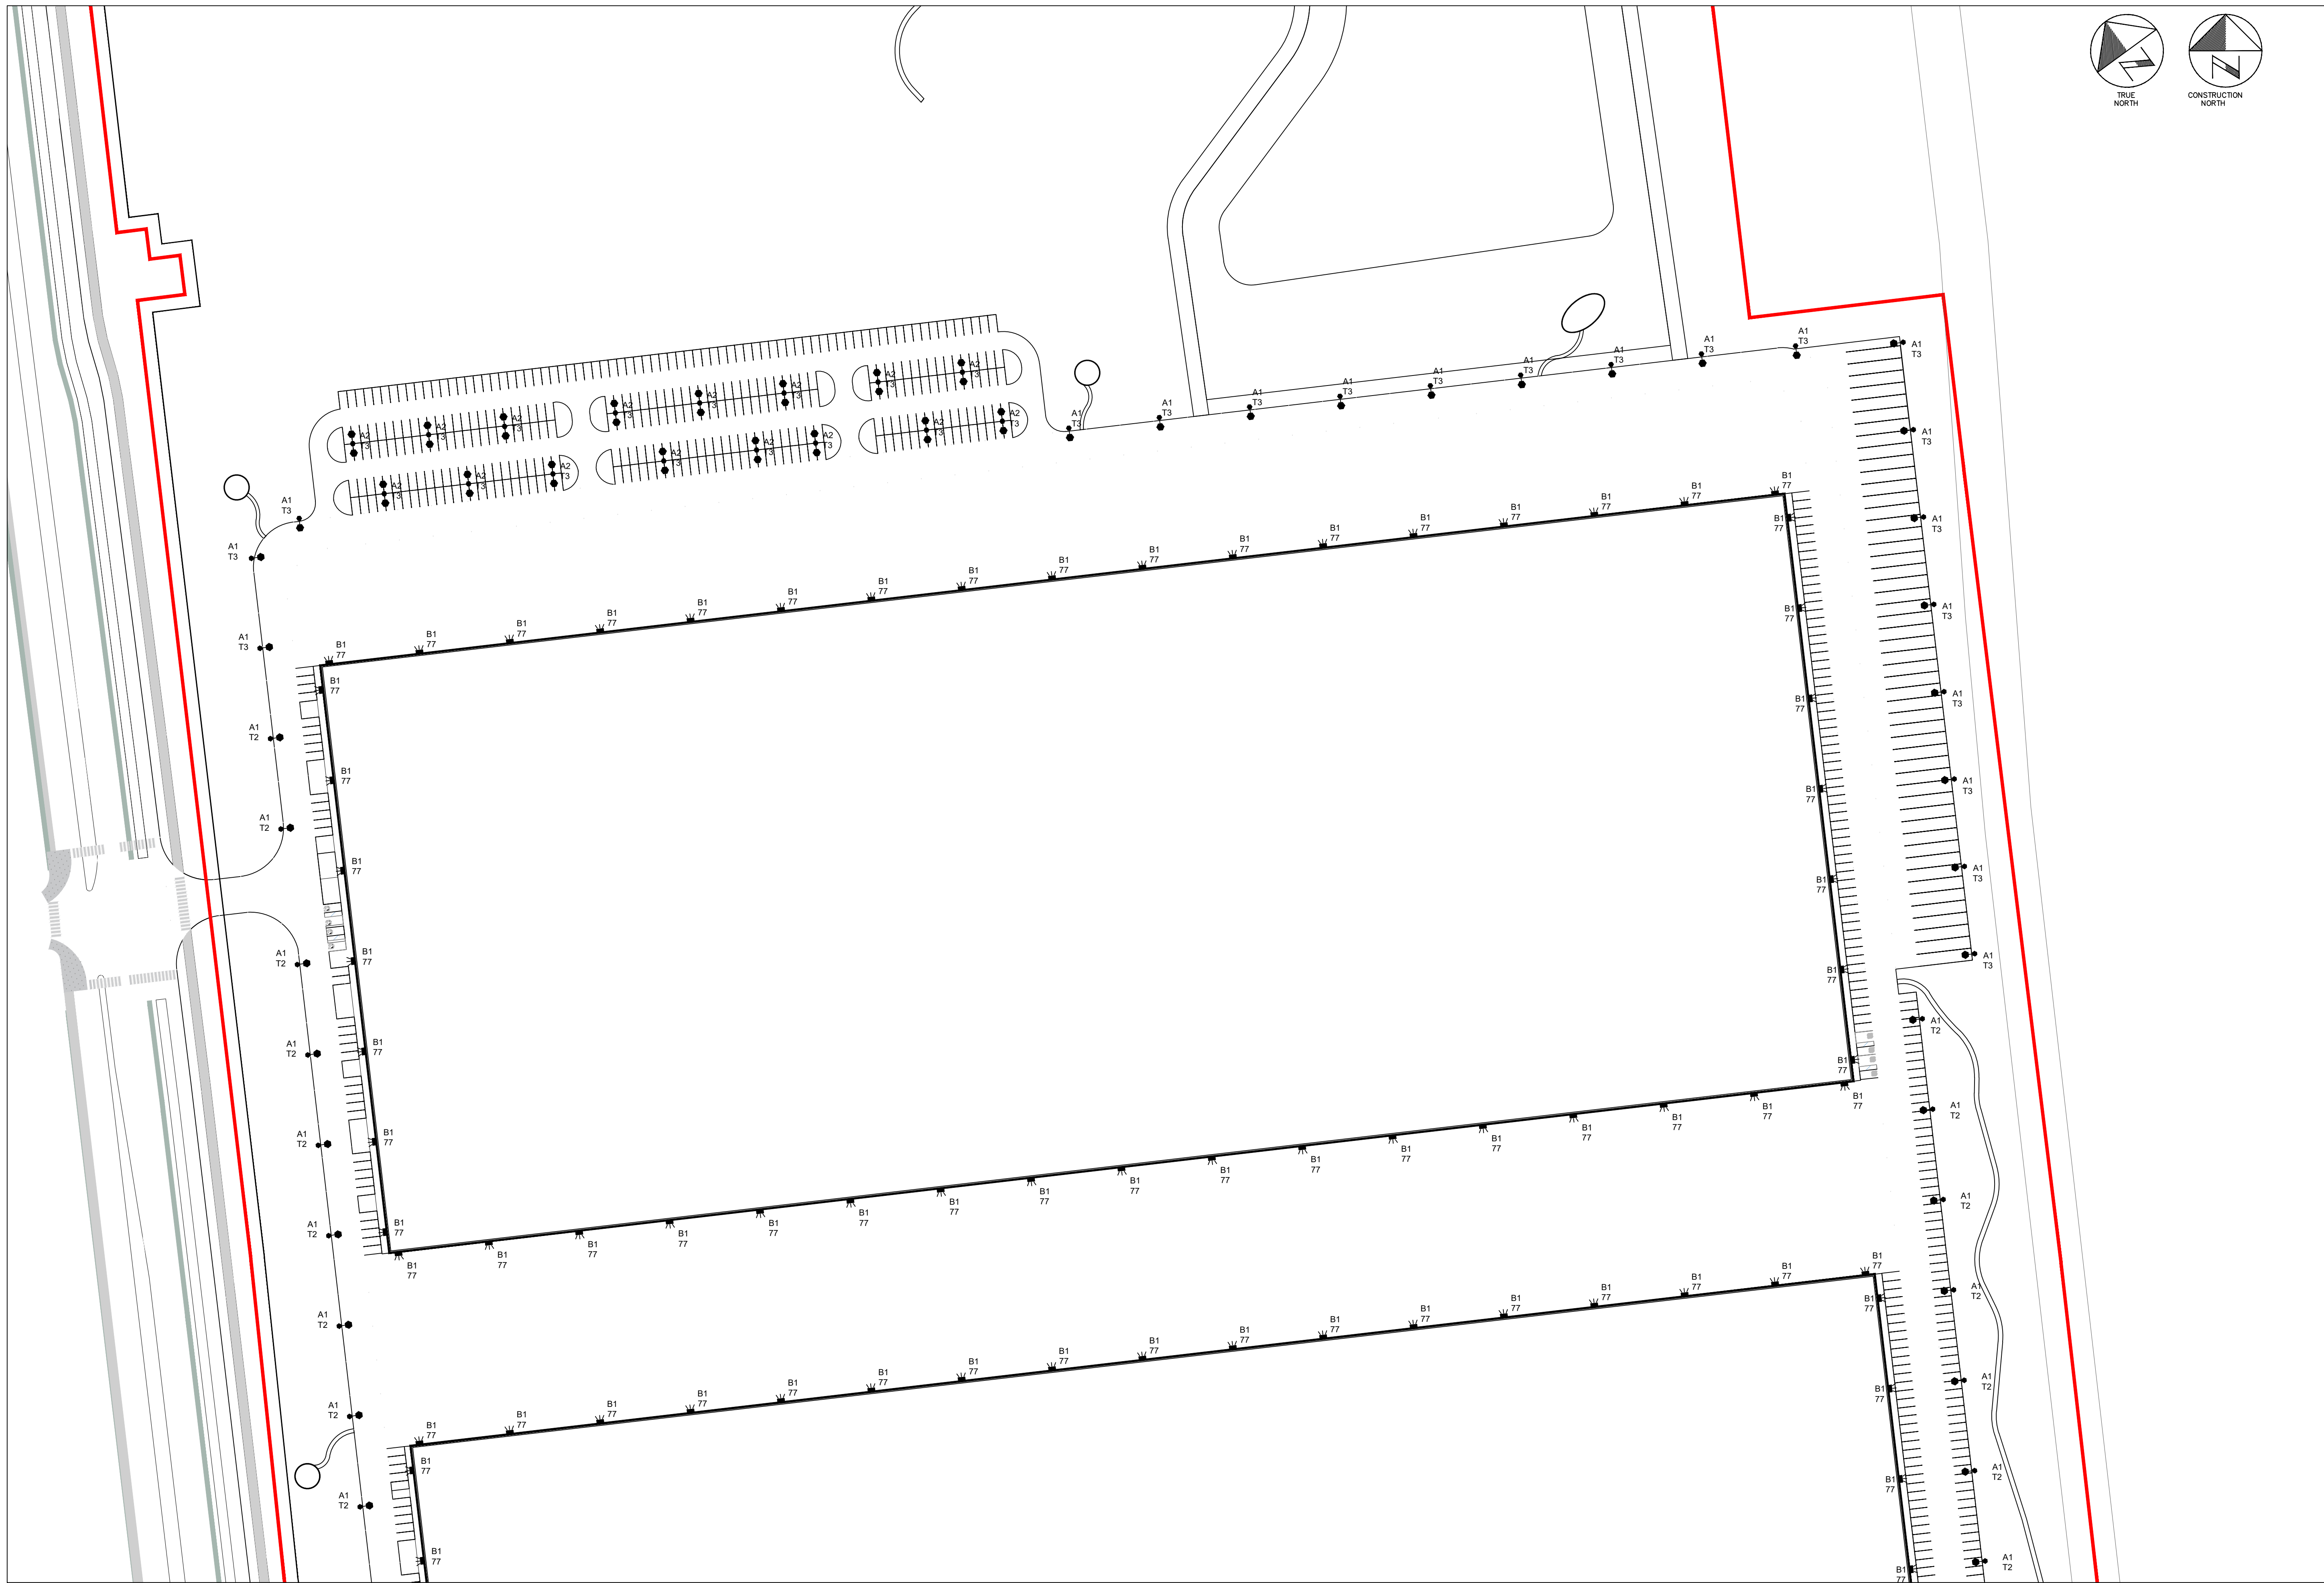

KEY PLAN

LEGEND

- Private Site Light Specification
25' Square Steel Pole, base mounted on Kellamy 610R
Anforms decorative concrete base, suitable for mounting
proposed EACL Area Light. Total Luminaire Height above
grade to be 8.52m (not to exceed 9.5m per Town of Milton)
- Luminaire to be GE Evolve EACL Series as noted below:
- A1 ● T2 73W LED 3000K (Type II Distribution where noted):
CAT # EACL-01-H-H2-AW-7-30-A-A-D1-BLCK-F-J-L
In Accordance With Photometric File
EACL01_H2AN730__IES
 - A1 ● T3 T3 73W LED 3000K (Type III Distribution where noted):
CAT # EACL-01-H-H3-AW-7-30-A-A-D1-BLCK-F-J-L
In Accordance With Photometric File
EACL01_H3AW730__IES
 - A2 ● T3 Double Assembly as above (T3 distribution) with two (2)
luminaires mounted 180° apart.
- Building Mounted Light Specification
Luminaire Height above grade to be 8.52m (not to exceed 9.5m
per Town of Milton)
- Luminaire to be GE EFM Series as noted below:
- 162W LED, NEMA 7x7 DISTRIBUTION c/w Knuckle Wall
Mount
CAT # EFM1-02-TBD-25-77-7-30-A-A-V1-BLCK
In Accordance With Photometric File EFM102_257730__IES
- Light to be installed with tilt of 45° for required spread. Include
Barn Door Shielding to prevent Light Trespass
- ALL LIGHTS TO BE DARK-SKY COMPLIANT.
BUILDING MOUNTED LIGHTS ARE TO INCLUDE SHIELDING
TO PREVENT LIGHT TRESPASS.

REVISIONS

RTG SYSTEMS INC.
ELECTRICAL CONSULTING ENGINEERS

3518 MAINWAY, SUITE 201
BURLINGTON, ONTARIO L7M 1A8
E-MAIL: GENERAL@RTGSYSTEMS.COM

Office (905) 335-4470
Toll (800) 827-7887

06600-00






MILTON LINK
INDUSTRIAL ILLUMINATION
SITE LIGHTING

SCALE	1:1000	DATE	2026.03.17
DRAWN	S.C.G.	DRAFTING	
U/G DESIGN	S.C.G.	O/H DESIGN	
ENGINEER	S.C.G.	WO#	XX-XXX

DRAWING No. SITE-L-2 SHEET 2 OF 3

PHOTOMETRIC ANALYSIS HAS BEEN
PREPARED IN AGI32. FOR SPECIFIC AREAS
OF INTEREST, DETAILED PHOTOMETRICS
CAN BE SUPPLIED BY RTG SYSTEMS AT
AN INCREASED SCALE FOR CLARITY.



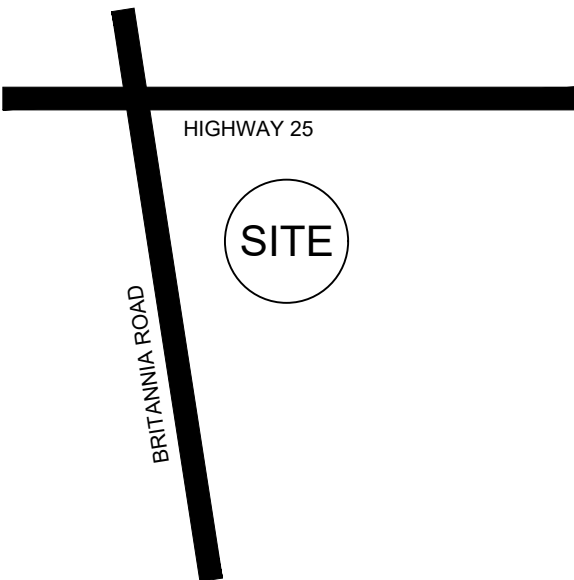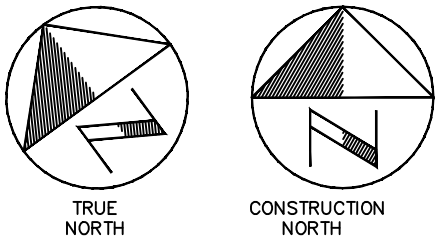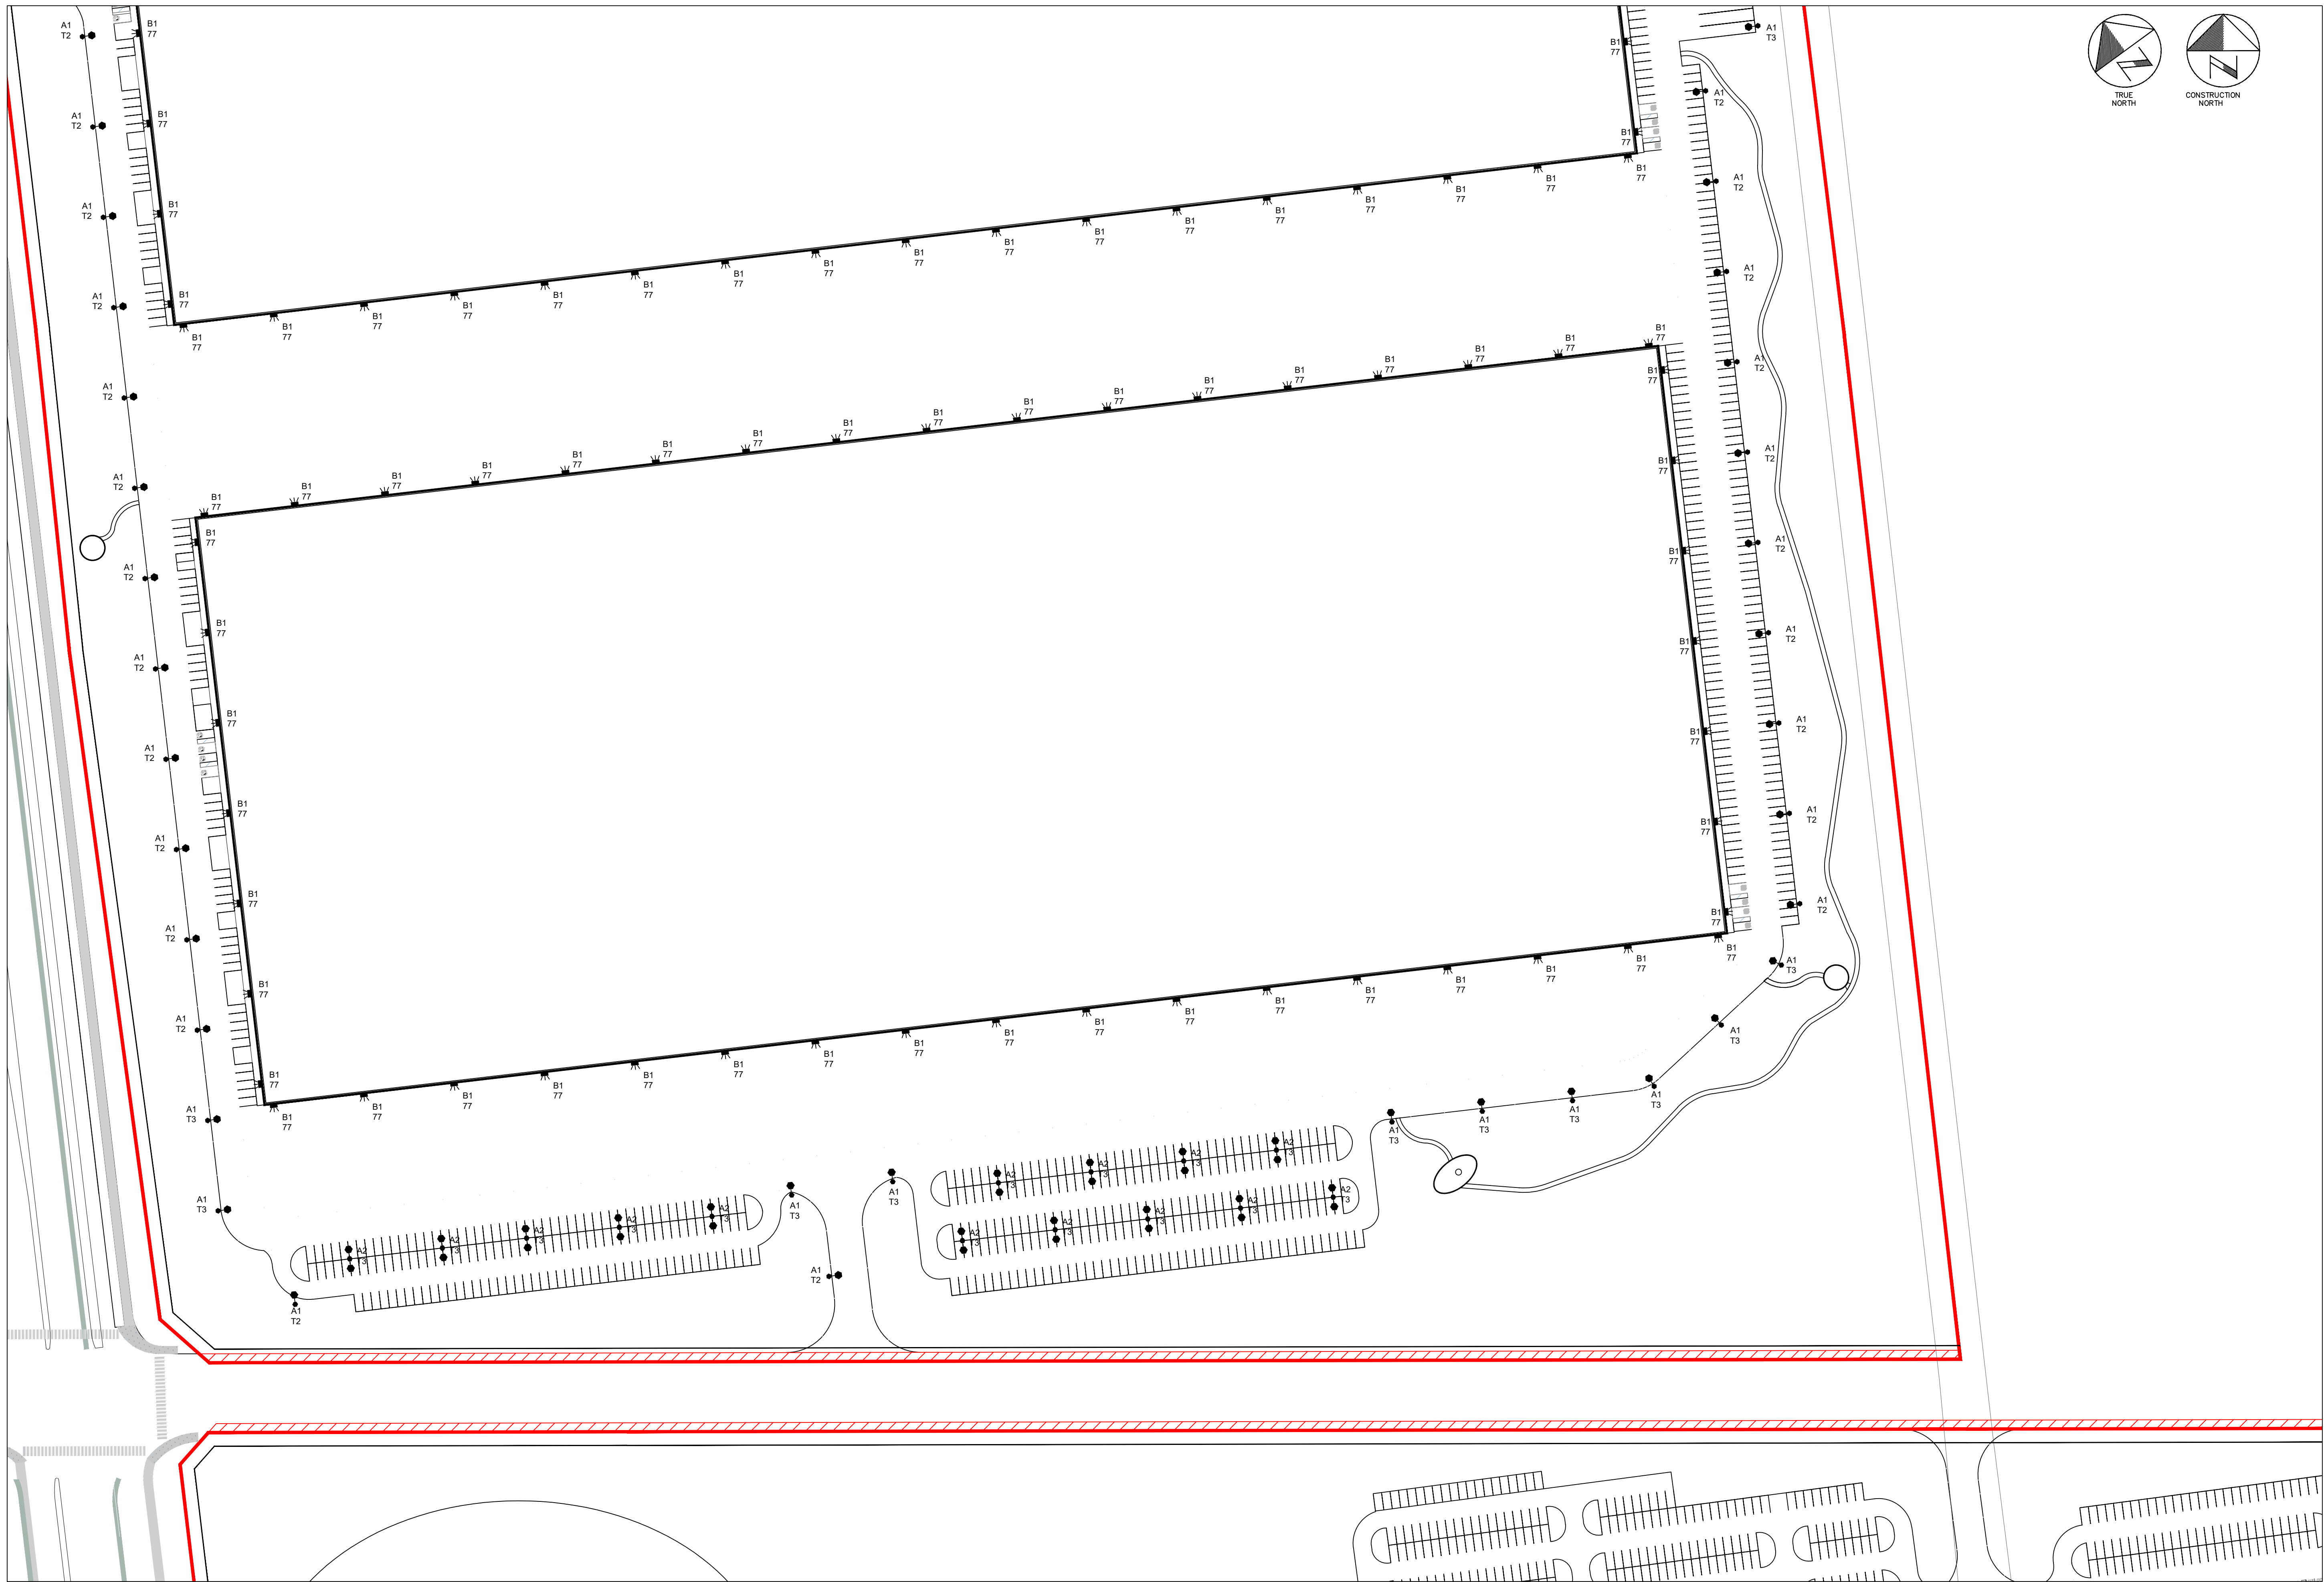

KEY PLAN
LEGEND

Private Site Light Specification
25' Square Steel Pole, base mounted on Kellamy 610R
Aforms decorative concrete base, suitable for mounting
proposed EACL Area Light. Total Luminaire Height above
grade to be 8.52m (not to exceed 9.5m per Town of Milton)

Luminaire to be GE Evolve EACL Series as noted below:

A1 ● T2 73W LED 3000k(Type II Distribution where noted):
CAT #: EACL-01-H-H2-AW-7-30-A-A-D1-BLCK-F-J-L
In Accordance With Photometric File
EACL01_H2AN730__IES

A1 ● T3 73W LED 3000k(Type III Distribution where noted):
CAT #: EACL-01-H-H3-AW-7-30-N-A-D1-BLCK-F-J-L
In Accordance With Photometric File
EACL01_H3AW730__IES

A2 ● T3 Double Assembly as above (T3 distribution) with two (2)
luminaires mounted 180° apart.

B1 77 Building Mounted Light Specification
Luminaire Height above grade to be 8.52m (not to exceed 9.5m
per Town of Milton)

Luminaire to be GE EFM Series as noted below:

162W LED, NEMA 7x7 DISTRIBUTION c/w Knuckle Wall
Mount
CAT #: EFM1-02-TBD-25-77-7-30-A-A-V1-BLCK
In Accordance With Photometric File EFM102_2577730__IES

Light to be installed with tilt of 45° for required spread. Include
Barn Door Shielding to prevent Light Trespass

ALL LIGHTS TO BE DARK-SKY COMPLIANT.
BUILDING MOUNTED LIGHTS ARE TO INCLUDE SHIELDING
TO PREVENT LIGHT TRESPASS.

REVISIONS

RTG SYSTEMS INC.
ELECTRICAL CONSULTING ENGINEERS

3518 MAINWAY, SUITE 201
BURLINGTON, ONTARIO L7M 1A8
E-MAIL: GENERAL@RTGSYSTEMS.COM

Office (905) 335-4470
Toll (800) 827-7887

06600-00



MILTON LINK
INDUSTRIAL ILLUMINATION
SITE LIGHTING

SCALE	1:1000	DATE	2026.03.17
DRAWN	S.C.G.	DRAFTING	
U/G DESIGN	S.C.G.	O/H DESIGN	
ENGINEER	S.C.G.	WO#	XX-XXX

PHOTOMETRIC ANALYSIS HAS BEEN
PREPARED IN AGI32. FOR SPECIFIC AREAS
OF INTEREST, DETAILED PHOTOMETRICS
CAN BE SUPPLIED BY RTG SYSTEMS AT
AN INCREASED SCALE FOR CLARITY.

